

FRAGILITY VULNERABILITY ASSESSMENT

Date: 9/17/2018
 Building Type: RC2/HR/PD
 Author: UNIANDES
 Sheet: 1 de 3

REINFORCED CONCRETE BUILDINGS

GENERAL INFORMATION

Index Building Taxonomy Code:

1. Main structural system:.....
2. Height range:.....
3. Seismic design level:.....
4. Diaphragm Type:.....
5. Structural Irregularity:.....
6. Span Length:.....
7. Pier Type:.....
8. Foundation Type and Flexibility:.....
9. Seismic Pounding Risk:.....
10. Seismic Retrofitting:.....
11. Structural Health Conditions:.....
12. Vulnerable Non-Structural Components:.....

RC2/HR/PD/RD/NI/SS/SW/RF/NP/OS/GC/VN

RC1 ☐	RC2 ☒	RC3 ☐	RC4 ☐	RC5 ☐
	Low (LR) ☐		Medium (MR) ☐	High (HR) ☒
Poor (PD) ☒	Low (LD) ☐		Medium (MD) ☐	High (HD) ☐
	Flexible diaphragm (FD) ☐		Rigid diaphragm (RD) ☒	
No irreg. (NI) ☒	Hor. (HI) ☐	Vert. (VT) ☐		Hor. and vert. (HV) ☐
	Short span (SS) ☒		Slender - weak column (SW) ☐	
	Regular column (RO) ☒		Regular column (RO) ☐	
	Rigid foundation (RF) ☒		Flexible foundation (FF) ☐	
	No pounding (NP) ☒		Pounding risk (PR) ☐	
	Original structure (OS) ☒		Retrofitted structure (RS) ☐	
	Good condition (GC) ☒		Poor condition (PC) ☐	
	Non vulnerable (NN) ☐		Vulnerable (VN) ☒	

INTRINSIC CHARACTERISTICS

General Geometry:

Building plane area (m ²):.....	630
Building total area (m ²):.....	3150
Number of stories:.....	5
Story height (m):.....	3
Number of spans in X direction:.....	8
Typical span length in X direction (m):.....	4.5
Number of spans in Y direction (m):.....	3
Typical span length in Y direction (m):.....	7
Foundation system:.....	CISF
Typical column dimensions (cm x cm):.....	25X30
Typical beam dimensions (cm x cm):.....	20X30
Typical shear wall dimensions (cm x cm):.....	-
Typical bracing member section (cm x cm):.....	-

Material properties:

Concrete:..... f _c (MPa):	17	Ec (GPa):	19
Reinforcement:..... f _y (Mpa):	420	Es (GPa):	200
Structural steel:..... f _y (Mpa):	-	Es (GPa):	-
Masonry:..... f _m (MPa):	-	γ:	-

Infill walls:


Infill type:.....		Interior walls		Facade walls	
Wall height (m):.....	X	-	Y	3	X
Depth (m):.....	X	-	Y	0.15	X
Isolated from structure:.....	Yes	☒	No	☐	Yes
					No

SEISMIC BEHAVIOR

Total weight (D) (kN):.....	14610
Total weight (L) (kN):.....	2841
T ₁ uncracked (sec):.....	0.245
T ₁ cracked (sec):.....	0.27

MODELLING PARAMETERS

3D Numerical model:

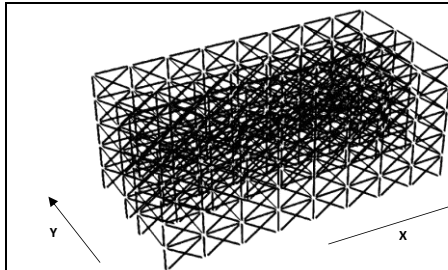

Modelling considerations:

Plasticity model:.....	Lumped ☒	Distributed ☐
Infill walls modelling approach:.....	Equivalent frame	
Roof Diaphragm:.....	Rigid ☒	Flexible ☐
Foundation:.....	Rigid ☒	Flexible ☐
	kv (kN) _____	kh (kN) _____
		kθ (kN) _____

Loads:

Over imposed design dead load (D) (kN/m ²):.....	1.2
Design Live load (L) (kN/m ²):.....	1.0
Load combination in non-linear analysis:.....	D+0.25L
Average load per square meter (kN/m ²):.....	5.5

Analysis considerations:

Global P-Delta effects:.....	Yes ☒	No ☐
Rigid zones:.....	Yes ☒	No ☐
Initial effective stiffness:.....	Beams ☐ 0.35	Columns ☐ 0.30
Analysis direction:.....	X ☒	Y ☐
Analysis orientation:.....	(+) ☒	(-) ☐

1st mode mass participation (%):.....	87.54
First floor column area (m ²):.....	2.7
Total weight (D+L) / columns area (%f _c):.....	38.02
Horizontal first story shear column capacity (g):.....	0.106


FRAGILITY VULNERABILITY ASSESSMENT

Date: 9/17/2018
Building Type: RC2/HR/PD
Author: UNIANDES
Sheet: 2 de 3

REINFORCED CONCRETE BUILDINGS

SEISMIC BEHAVIOR


Capacity Curve:

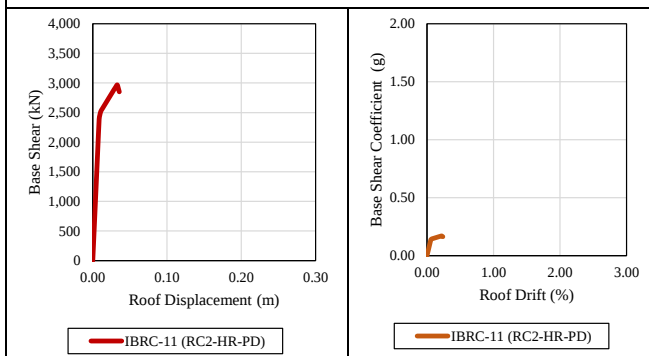

Idealized capacity curve:

Behavior point	Base shear (kN)	Displacement (m)
Yield point:.....	2450	0.009
Maximum capacity:.....	2910	0.0350
Ultimate capacity:.....	-	-

Collapse mechanism: Soft story

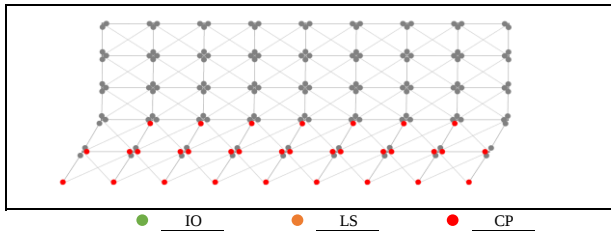

NON-LINEAR ANALYSIS PARAMETERS


Seismic ground motions:

Number of ground motions used:..... 22
Soil type:..... C
Source type:..... Far field
Retrieved from:..... PEER-NGA


Analysis considerations:

Non-linear analysis:..... Static ☒ Dynamic ☐
Analysis methodology:..... N2
Intensity measure parameter (IM):..... Sa[T] (g)
Scaling factor:..... 0.1 Minimum:..... 0.1 Maximum:..... 2

Ground motion spectra:

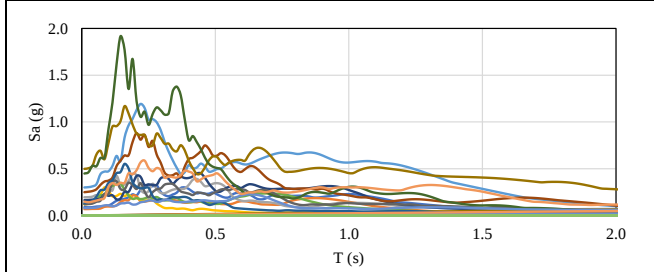

Illustrative EDP:

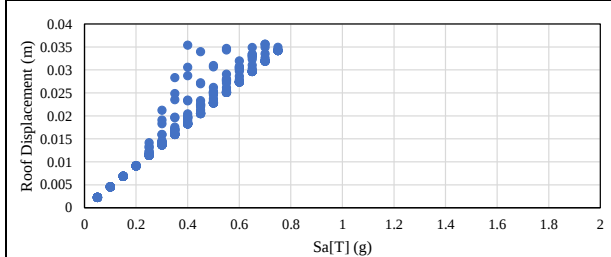


FRAGILITY ASSESSMENT

Damage states (DS):

Intensity Measure:..... Sa[T] (g)
Slight (SD) - Operational (OP) (%):..... 0.05
Medium (MD) - Immediate occupancy (IO) (%):..... 0.10
Extensive (ED) - Life safety (LS) (%):..... 0.15
Collapse (CD) - Collapse prevention (CP) (%):..... 0.20
Integration methodology:..... LSM

	OP	IO	LS	CP:
Mean:.....	0.17	0.33	0.45	0.61
Deviation:.....	0.15	0.18	0.24	0.37

Fragility function:

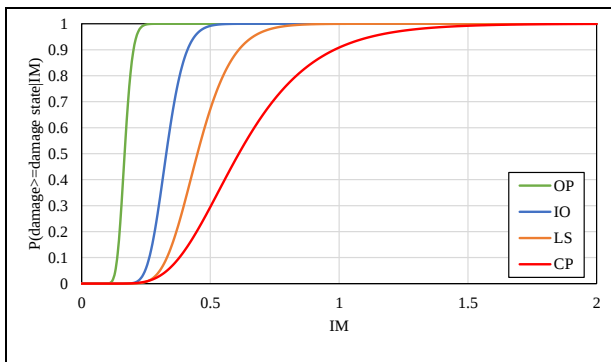

FRAGILITY VULNERABILITY ASSESSMENT

Date:	9/17/2018
Building Type:	RC2/HR/PD
Author:	UNIANDÉS
Sheet:	3 de 3

REINFORCED CONCRETE BUILDINGS

VULNERABILITY ASSESSMENT

Component model:

Story	Group	Subgroup	Description	Unit	Quantity	Fragility curve	EDP	Correlation
1	E	C1	Column-one beam	Node	8	B1041.091a	Drift	0
1	E	C2	Column-two beams	Node	21	B1041.091b	Drift	0
1	A	F2	Masonry facade	5m x 3m	14	C1011.006a	Drift	1
1	A	M4	Masonry wall	5m x 3m	6	C1011.006b	Drift	1
1	C	S2	Contents	5m x 5m	13	E2022.010a	Drift	0
2	E	C1	Column-one beam	Node	8	B1041.091a	Drift	0
2	E	C2	Column-two beams	Node	21	B1041.091b	Drift	0
2	A	F2	Masonry facade	5m x 3m	14	C1011.006a	Drift	1
2	A	M4	Masonry wall	5m x 3m	6	C1011.006b	Drift	1
2	C	S2	Contents	5m x 5m	13	E2022.010a	Drift	0
3	E	C1	Column-one beam	Node	8	B1041.091a	Drift	0
3	E	C2	Column-two beams	Node	21	B1041.091b	Drift	0
3	A	F2	Masonry facade	5m x 3m	14	C1011.006a	Drift	1
3	A	M4	Masonry wall	5m x 3m	6	C1011.006b	Drift	1
3	C	S2	Contents	5m x 5m	13	E2022.010a	Drift	0
4	E	C1	Column-one beam	Node	8	B1041.091a	Drift	0
4	E	C2	Column-two beams	Node	21	B1041.091b	Drift	0
4	A	F2	Masonry facade	5m x 3m	14	C1011.006a	Drift	1
4	A	M4	Masonry wall	5m x 3m	6	C1011.006b	Drift	1
4	C	S2	Contents	5m x 5m	13	E2022.010a	Drift	0
5	E	C1	Column-one beam	Node	8	B1041.091a	Drift	0
5	E	C2	Column-two beams	Node	21	B1041.091b	Drift	0
5	A	F2	Masonry facade	5m x 3m	14	C1011.006a	Drift	1
5	A	M4	Masonry wall	5m x 3m	6	C1011.006b	Drift	1
5	C	S2	Contents	5m x 5m	13	E2022.010a	Drift	0

Phase I:

Beta model uncertainty:..... 0.3

Number of iteration for model uncertainty:..... 20

Number of iterations for damage states uncertainty:..... 20

Number of iterations for cost and time uncertainty:..... 20

Scale factor for cost:..... Yes ☐ No ☒

Phase II:

Lower intensity to no damage (g/g):..... 0.1


Maximum allowable residual drift for demolition (%):..... 1.5

Percentage of building replacement value (%):..... 100

Bidirectional factor for total cost model:..... 1

Intensity level for building evacuation (g/g):..... 2

Vulnerability function:

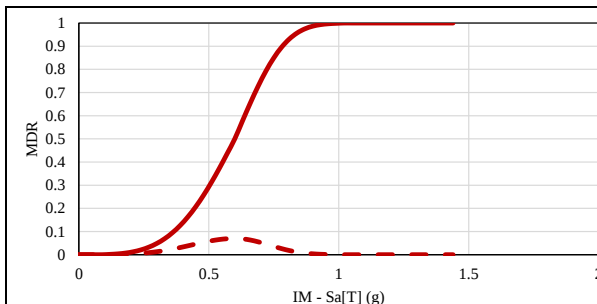

Fragility to vulnerability weighting percentage:

OP (%): 0 IO (%): 10 LS (%): 50 CP (%): 100

GLOSSARY

fc: Compressive concrete strength	kv: Spring vertical stiffness	IM: Intensity measure
Ec: Concrete elastic module	kh: Spring horizontal stiffness	DM: Damage states
fy: Tensile steel strength	k0: Spring rotational stiffness	OP: Operational
Es: Steel elastic module	D: Death load	IO: Immediate occupancy
f _m : Masonry compressive strength	L: Live load	LS: Life safety
γ: Masonry density	T1: First mode period	CP: Collapse prevention
CISF: Concrete isolated spread footing	Sa: Pseudo acceleration	EDP: Engineering demand parameters

Horizontal first story shear column capacity (g) = $(\sqrt{f_c}/6) \cdot (A_{col}/W)$

PRINCIPAL REFERENCES

Reference project:..... Global Library of School Infrastructure - GLoSI

Main bibliographical references:.....

- GLoSI Technical Report
- FEMA P-695
- ASCE 41-17
- N2 Method (Fajfar, 2000)
- GEM Analytical Vulnerability Assessment Guideline (D'Ayala et al, 2015)
- FUNVUL (www.ecapra.org)